


# ARAKALAGUD TALUK



## FLUORIDE CONTENT IN DRINKING WATER BOREWELLS

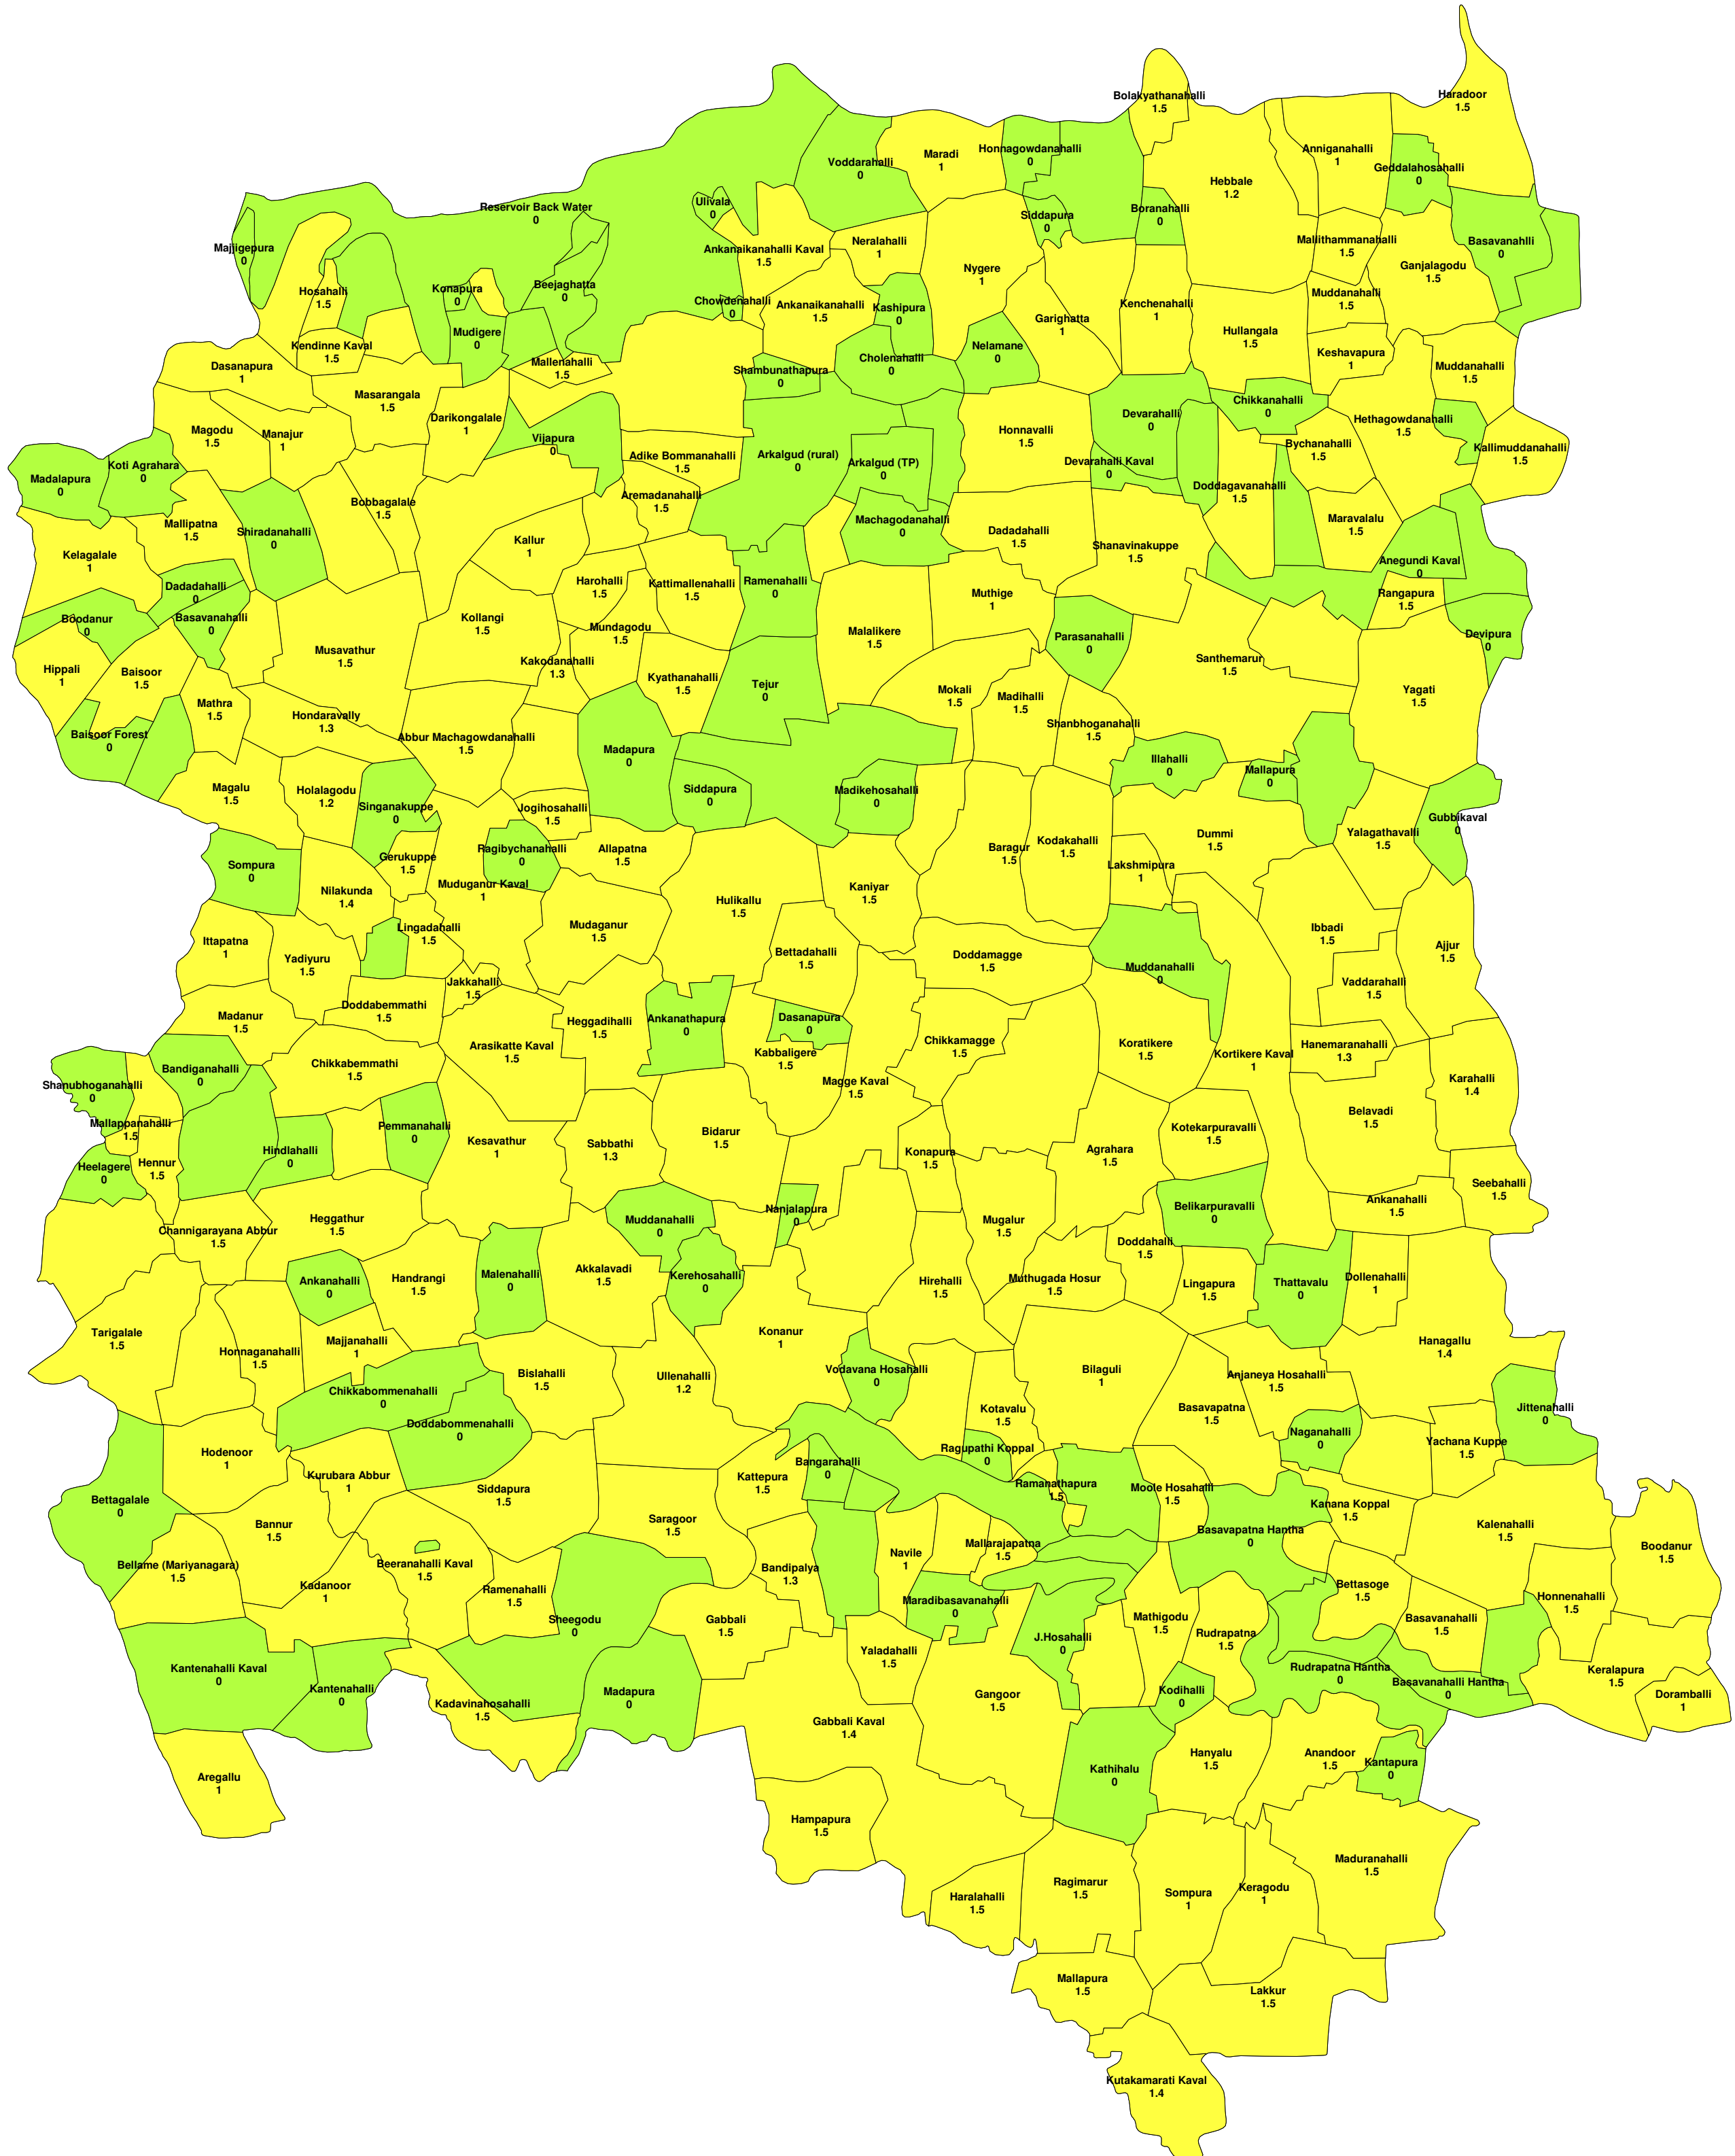

**FLUORIDE CONTENT**  
mg/l  
0 to 1 (103)  
1 to 1.5 (195)

PREPARED AT : NRDMS CENTRE/ZP/HASSAN.